



Note:


- The flue cowl should have a 500mm clearance from any point of the building
- Total flue length can be 7.5m
- 2° fall back to heater

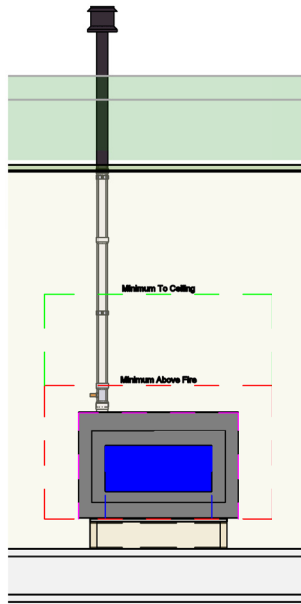


Front

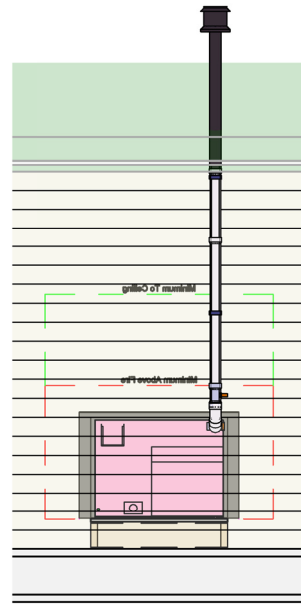

Back View

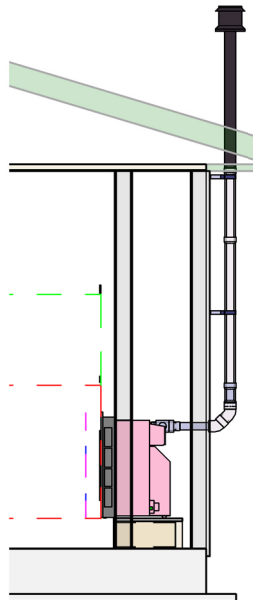

Left

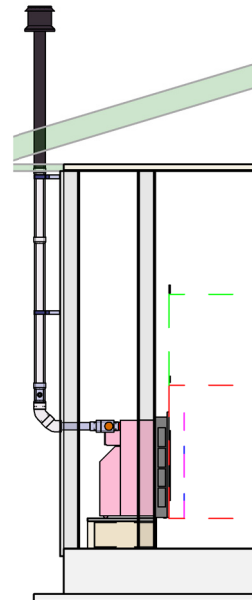

Right